



ALA S.p.A.  
Via Lenin, 29/A | 42020 Quattro Castella RE IT  
Tel. +39 0522 887 424 | Fax +39 0522 887 426  
www.ala-spa.it | info@ala-spa.it  
Cap. soc. € 1.500.000,00 i.v. R.E.A. RE 247500  
Codice fiscale e p. IVA 02216830345

Quattro Castella, 22<sup>nd</sup> June 2020

**TO ALL OUR CUSTOMERS**

## INFORMATION CIRCULAR

N. 012020

**Subject : Updating of the installation instruction of ALA PELLET AETERNUM**

With reference to the previous communication n.012019, containing the indications and installation suggestions in the case of high performance appliances fueled with solid fuels (wood, pellets), we want to inform you of the recent evolution in terms of certification and installation methods of the range in subject.



The novelties are illustrated below.



ALA S.p.A.  
Via Lenin, 29/A | 42020 Quattro Castella RE IT  
Tel. +39 0522 887 424 | Fax +39 0522 887 426  
www.ala-spa.it | info@ala-spa.it  
Cap. soc. € 1.500.000,00 i.v. R.E.A. RE 247500  
Codice fiscale e p. IVA 02216830345

For the range  thanks to the new technical designation

**T250 P1 W V2 L80120 O100 WITH VITON GASKET**



**it will now be possible to use it for pellet applications with smoke temperatures up to 250°C in operation using the specific *Viton* seals \***

\* article on request sold separately

- With the use of Viton seals, the pipes must be installed with the **"water" anti-condensation installation**, that is, with the male coupling at the bottom and the female part at the top.
- The same anti-condensation installation is recommended even with traditional silicone gaskets (by rotating the tube even if the label is "smoke" applied), alternatively carry out assembly by regularly following the smoke arrow (**"smoke" installation**).

Note: with the entry into force of the future update of the UNI 10683 Italian standard scheduled for the end of 2020, in which the presence of condensation should be allowed inside the smoke evacuation system (currently, however, there is no provision), the anti-condensation installation "water" will become mandatory in all cases (in Italy) – Please check and follow the regulations in force in your respective country.

- Finally, according to the DoP, a **"smoke" installation without gaskets is only possible in the presence of a dry operating regime** (= dry fumes / high smoke temperature, with the exclusion of condensation) - installation without gaskets.

**How does the label change ?**




The label does not change and remains applied by default for **"smoke" installation**, that is, with the smoke arrow from the female to the male coupling.



ALA S.p.A.  
Via Lenin, 29/A | 42020 Quattro Castella RE IT  
Tel. +39 0522 887 424 | Fax +39 0522 887 426  
www.ala-spa.it | info@ala-spa.it  
Cap. soc. € 1.500.000,00 i.v. R.E.A. RE 247500  
Codice fiscale e p. IVA 02216830345

## Declaration of performance DoP

The related updated DoP is available on [www.ala-spa.it](http://www.ala-spa.it)

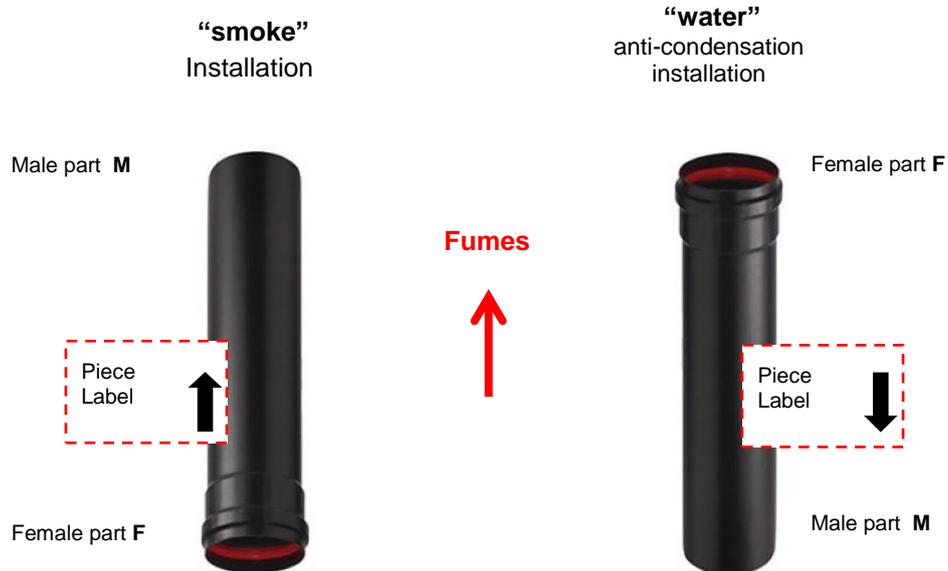

---

Finally, we remember that nothing changes in relation to the maximum quality and resistance against corrosion of acid condensates.

